



LDT-A2

Alexa 65, LF, SXT (Injection Recording)




[Download LDT-A2 manual](#)

Lens maps MUST be made on the LDT-R2, converted and transferred to the ALEXA camera. Only the LDT-A2 will be used when filming.

LDT-R2 Mapping Setup

Notes:
The LDT-R2 must be running firmware 1.49 or higher for lens conversion to work

Notes:
Preston MDR and Hand Unit MUST be running the latest firmwares

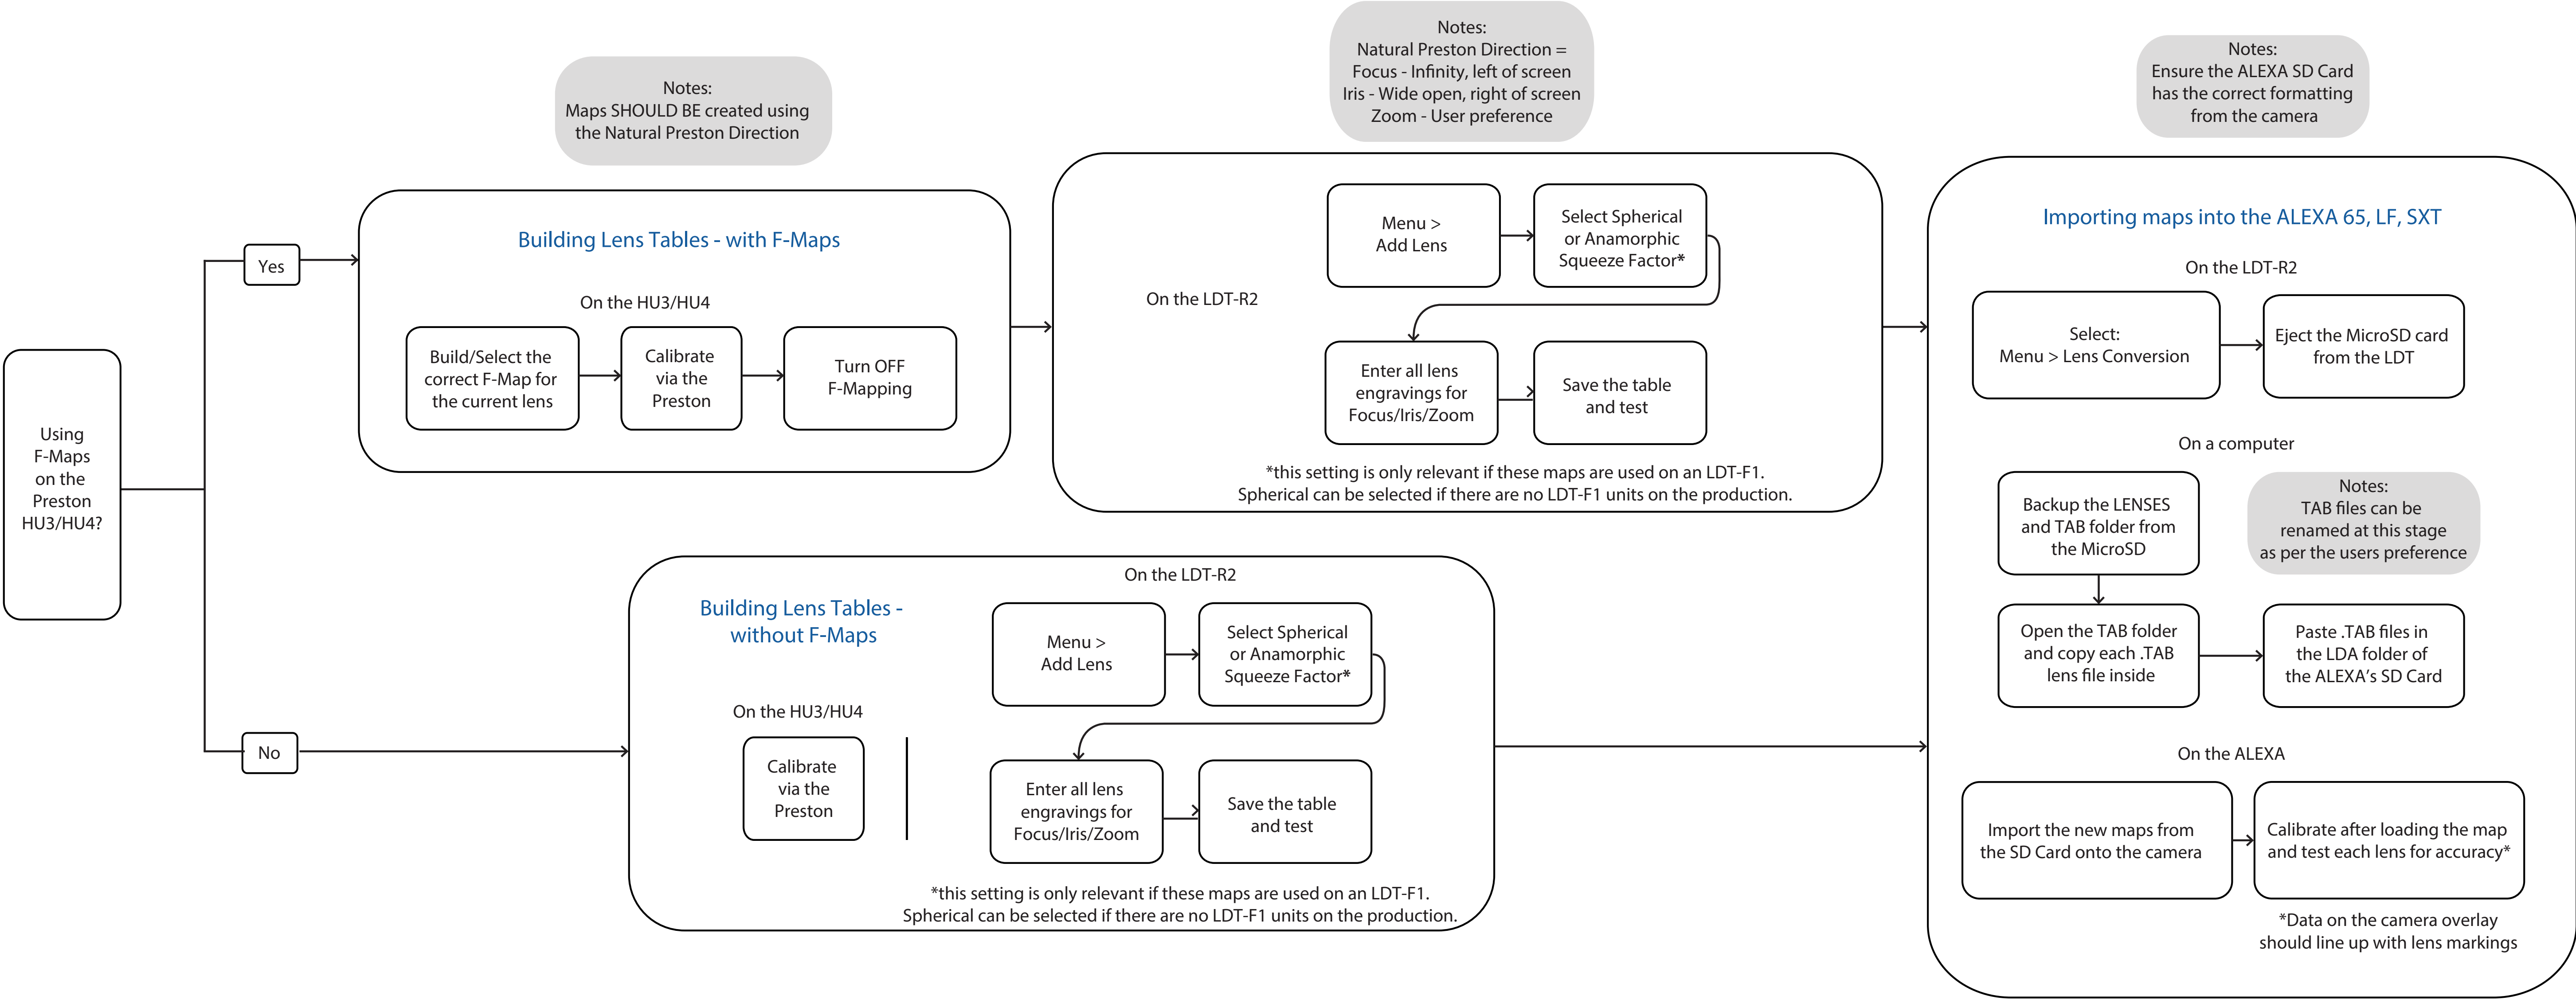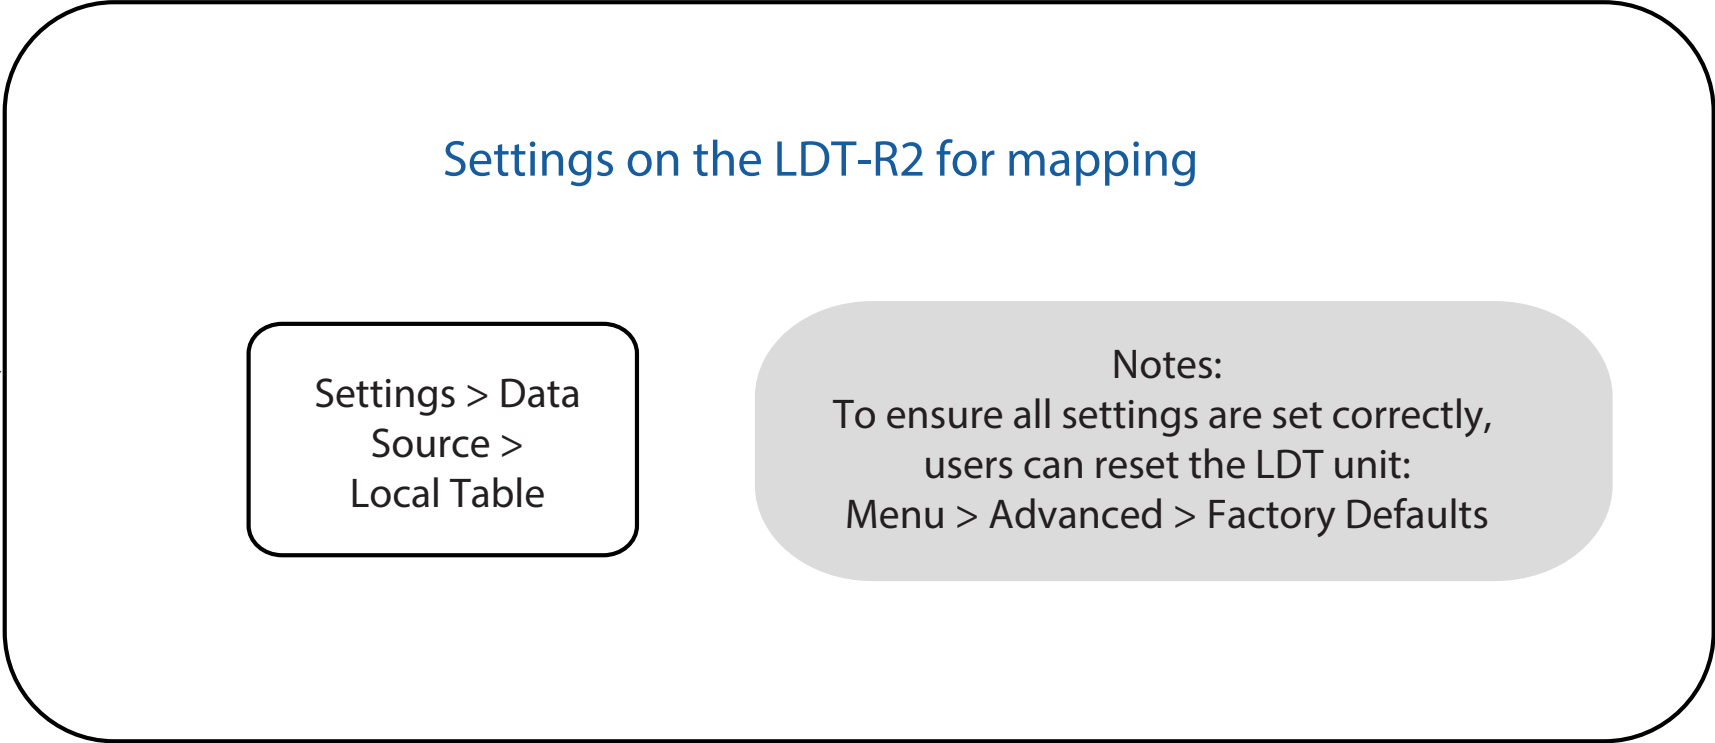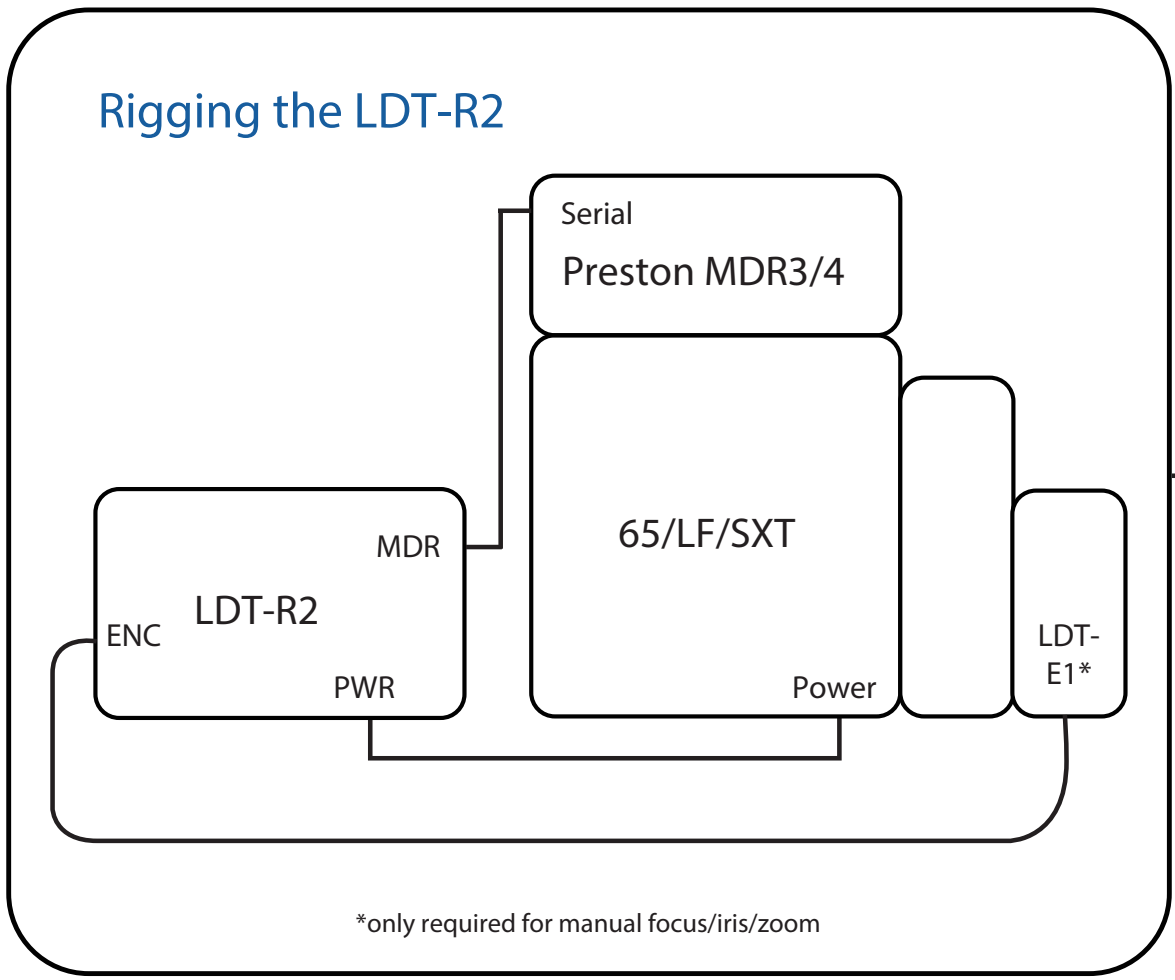

LDT-A2 Setup for regular use

